

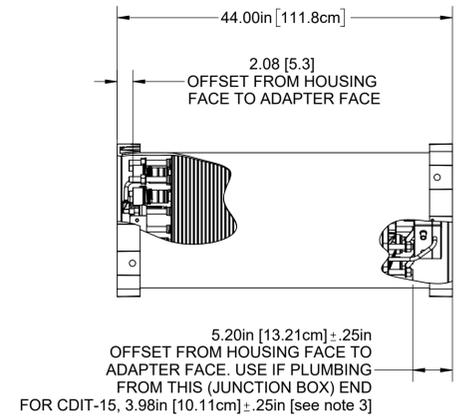
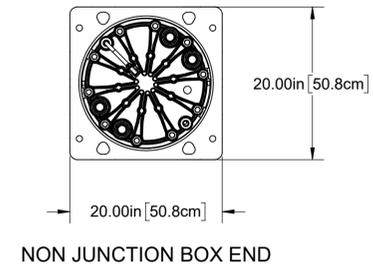


NOTES:



- 1. DRAWING PERTAINS TO: IP-VNX28-2, IP VNX-CDIT 15
- 2. SEE PRODUCT MANUAL FOR ALTERNATE FLOW PORT CONFIGURATIONS.
- 3. VNX-CDIT 15 HAS DIFFERENT ADAPTER OFFSET ON JUNCTION BOX SIDE.

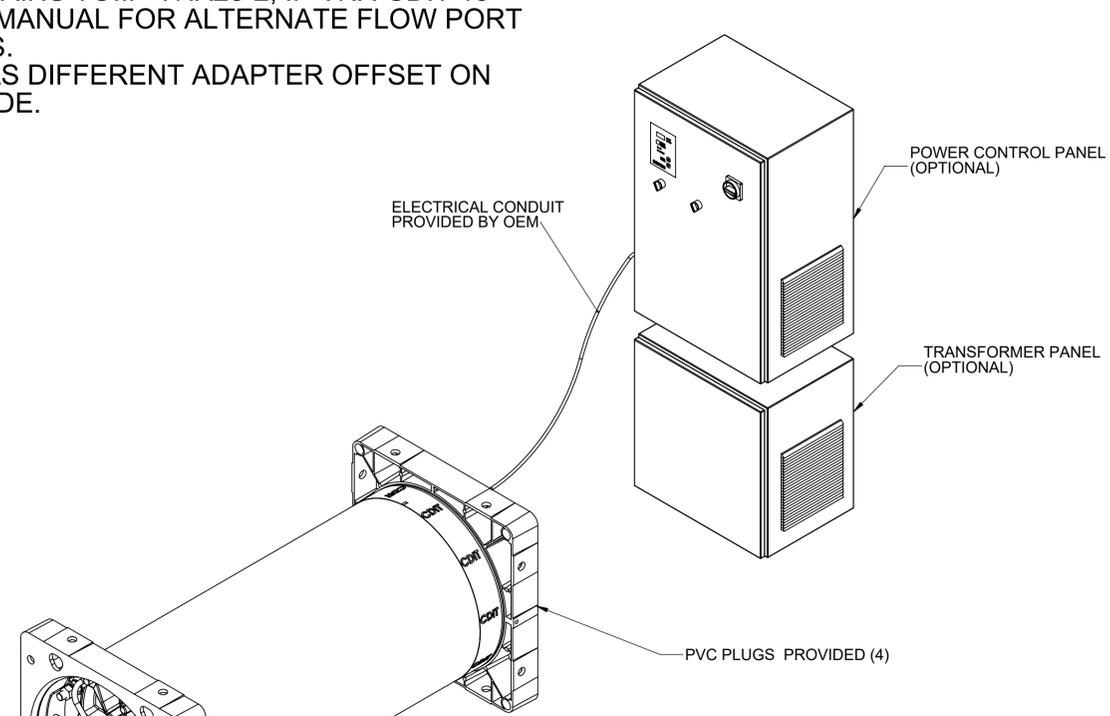

SIDE VIEW

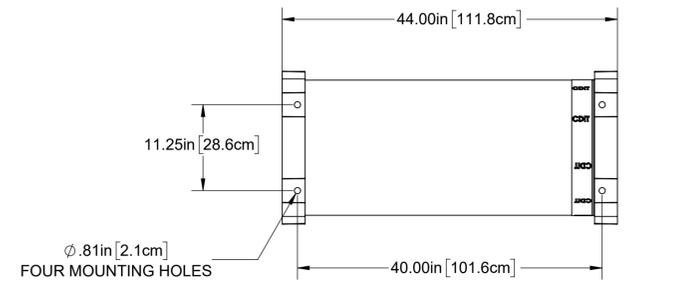

BOTTOM VIEW
SHOWING LOCATION OF AVAILABLE MOUNTING HOLES

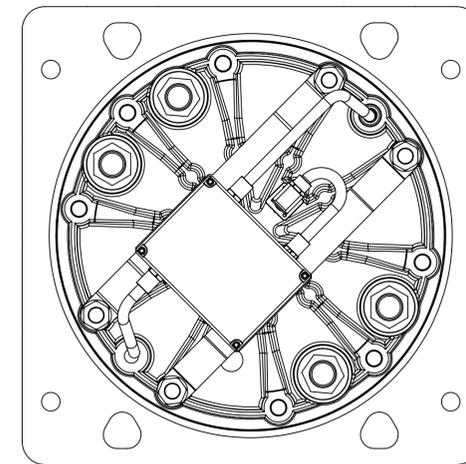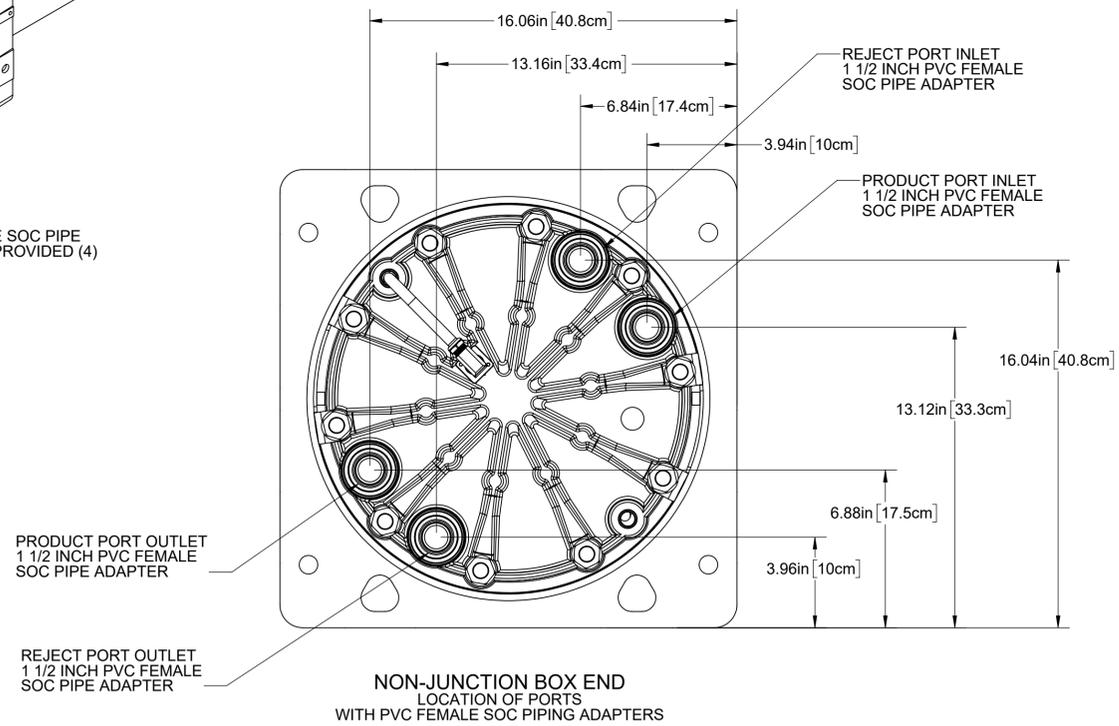

JUNCTION BOX END
LOCATION OF PORTS
WITH PVC PIPING PLUGS

<p>ALL DIMENSIONS ARE IN INCHES OR DEGREES UNLESS OTHERWISE SHOWN. ALL DISTANCE TOLERANCES UNLESS OTHERWISE SHOWN ARE: .XX ±0.1, .XX ±.01, .XXX ±.005. ALL ANGLE TOLERANCES UNLESS OTHERWISE SHOWN ARE X ±1°, XX ±0.1°.</p>						
REV	DESCRIPTION	DATE	DWN	CHKD	APVD	ECN
B	UPDATED TO NEW ENDBLOCK	3/2/18	HUJ			
A	INITIAL DESIGN	2/14/13	HRF			

COMPANY CONFIDENTIAL
THIS DOCUMENT AND ALL INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF SIEMENS AND/OR ITS AFFILIATES. THE DESIGN CONCEPTS AND INFORMATION CONTAINED HEREIN ARE PROPRIETARY TO SIEMENS AND ARE SUBMITTED IN CONFIDENCE. THEY ARE NOT TRANSFERABLE AND MUST BE USED ONLY FOR THE PURPOSE FOR WHICH THE DOCUMENT IS EXPRESSLY LOANED. THEY MUST NOT BE DISCLOSED, REPRODUCED, LOANED OR USED IN ANY OTHER MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF SIEMENS. IN NO EVENT SHALL THEY BE USED IN ANY MANNER DETRIMENTAL TO THE INTEREST OF SIEMENS. ALL PATENT RIGHTS ARE RESERVED. UPON THE DEMAND OF SIEMENS, THIS DOCUMENT, ALONG WITH ALL COPIES AND EXTRACTS, AND ALL RELATED NOTES AND ANALYSES, MUST BE RETURNED TO SIEMENS OR DESTROYED AS INSTRUCTED BY SIEMENS. ACCEPTANCE OF THE DELIVERY OF THIS DOCUMENT CONSTITUTES AGREEMENT TO THESE TERMS AND CONDITIONS.

DESIGNER	2/14/13
FRYE	
CHECKER	DATE
ENGINEER	DATE
MANAGER	DATE
FILE:	IP-VNX 44in housing
SCALE:	NA

TITLE
IP-VNX w/ 44 INCH HOUSING-LAYOUT AND ELVATION



PROJECT	707689	FORMAT	22X34 D	DRAWING	IP VNX 44in HOUSING	SHEET	1 OF 1	REV	B
---------	--------	--------	---------	---------	---------------------	-------	--------	-----	---